

CONFIRM LIGHTING FIXTURE QUANTITIES WITH SUPPLIER.

EMERGENCY AND NORMAL LIGHTING MARKED WITH "NL" SUBSCRIPT SHALL OPERATE CONTINUOUSLY. UNSWITCHED LIGHTING NOT TO NORMAL AND BATTERY BACK-UP.

EMERGENCY LIGHTING NOT MARKED WITH "NL" SUBSCRIPT SHALL OPERATE UNDER CONTROL OF LIGHTING SWITCH AS INDICATED.

ALL CONDUTS ENTERING OR LEAVING COOLER/FREEZER SHALL BE PROVIDED WITH SEAL-OFF FITTING WITH COMPOUND PER NEC 300-(7a).

ALL INTERIOR LIGHTING CIRCUITS TO BE WIRED THRU THE LIGHTING CONTROL RELAYS SEE 1/E6.0.

CONTRACTOR TO FIELD VERIFY CEILING TYPE AND PROVIDE PROPER MOUNTING HARDWARE.

ALL FIXTURES SUPPLIED WITH LAMPS.

LIGHTING FIXTURES IN AREAS WHERE FOOD IS PREPARED OR OPEN FOOD IS STORED, OR WHERE UTENSILS ARE CLEANED SHALL HAVE A SHATTER-PROOF LENS AND BE READILY CLEANABLE.

LIGHTING INTENSITY SHALL NOT BE LESS THAN 50 FOOT CANDLES AT ALL FOOD PREP AND SERVING SURFACES AND AT ANY SURFACE WHERE A FOOD EMPLOYEE IS WORKING WITH FOOD OR WORKING WITH UTENSILS OR EQUIPMENT SUCH AS KNIVES, SLICERS, GRINDERS OR SAWS WHERE EMPLOYEE SAFETY IS A FACTOR. E.C. SHALL VERIFY PRIOR TO HEALTH DEPARTMENT INSPECTION.


DRY FOOD STORAGE AND WALK-IN REFRIGERATION STORAGE SHALL NOT BE LESS THAN 10 FOOT CANDLES, AT + 30" ABOVE FLOOR.

LIGHTING INTENSITY SHALL NOT BE LESS THAN 20 FOOTCANDLES:

a. AT A SURFACE WHERE FOOD IS PROVIDED FOR CONSUMER SELF-SERVE SUCH AS BUFFETS AND SALAD BARS OR WHERE FRESH PRODUCE OR PACKAGED FOODS ARE SOLD OR OFFERED FOR CONSUMPTION;

b. INSIDE EQUIPMENT SUCH AS REACH-IN AND UNDER-COUNTER REFRIGERATORS;

c. AT A DISTANCE OF THIRTY INCHES ABOVE THE FLOOR IN AREAS USED FOR HANDWASHING, AREAWASHING, EQUIPMENT AND UTENSIL STORAGE, AND IN TOILET ROOMS.

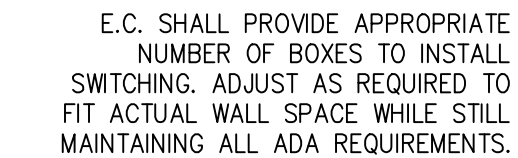


THE LISTED LIGHT FIXTURE PACKAGE CAN BE BID DIRECTLY OR ORDERED FROM A ACCUSERV (LIGHTING DISTRIBUTOR). CONTACT BUDDY BOCKWEG 502-961-0096 X19.

- B-6 ⤵ TO LOT LIGHTS
 B-8 ⤵ (AS NEEDED)
 B-10 ⤵
 B-29 ⤵ TO PYLON SIGN
 B-28 ⤵ DIGITAL MENU BOARDS
 B-15 ⤵ MENU BOARD CANOPY LTS
 B-11 ⤵ TO HOT BOX HEAT TAPE
 B-30 ⤵ TO OCB/SPEAKERS

A

1	INDICATED CIRCUITS ARE FOR SITE. SEE CIVIL FOR MORE INFORMATION.
2	INDICATES LIGHTING FIXTURES PROVIDED WITH WALK-IN COOLER. REFER TO GENERAL NOTE D.
3	WALK-IN COOLER / FREEZER - SEE SCOPE OF WORK.
4	EXHAUST HOOD LIGHT FIXTURES SUPPLIED WITH HOOD AND MTD IN PRE-WIRED J-BOX.
5	COORD. J-BOX LOCATION SO IT REMAINS CONCEALED BEHIND FIXTURE. VERIFY MOUNTING HEIGHT WITH ARCH. DWGS.
6	REST ROOM EXHAUST FANS TO BE WIRED VIA TIME CLOCK SUCH THAT EXHAUST FANS REMAIN ON WHILE BUILDING IS OCCUPIED. SEE DETAIL 1/E6.
7	CANOPY DOWN LIGHTS FURNISHED WITH CANOPY. G.C. TO MAKE FINAL CONNECTION.
8	J-BOX FOR CANOPY LIGHTS. VERIFY POINT OF CONNECTION. WIRE VIA EXTERIOR LIGHTING CONTACTOR.
9	NIGHT LIGHT.
10	C1BE FIXTURES WIRED THROUGH INVERTER E3 ON CIRCUIT B-2. COORDINATE INVERTER LOCATION PER MANUFACTURER SPECS.
11	J-BOX FOR COOLER/FREEZER LIGHTS. COORDINATE WITH MANUFACTURER.
12	WATERTIGHT ELECTRICAL CONDUITS.
13	COORDINATE THE POSITION OF LIGHT FIXTURES WITH THE POSITION OF THE TABLES BELOW.
14	ALERT LIGHT : ONLY APPLIES WHEN A GEN IV POWER SOAK IS USED. DISREGARD IF GEN III POWER SOAK IS USED. SEE SHEET E3.0 FOR POWER REQUIREMENTS.
15	REFER TO ARCHITECTURAL EXTERIOR ELEVATIONS ON A4.0 AND A4.1 FOR DIMENSIONED LOCATION OF FIXTURE.

E



CONTRACT DATE:	XXXXX
BUILDING TYPE:	XXXXX
PLAN VERSION:	XXXXX
SITE NUMBER:	315669
STORE NUMBER:	XXXXX

SPEARS CREEK CHURCH RD.
ELGIN, SC 29045



ENDEAVOR 2.0

LIGHTING PLAN AND SCHEDULE

E4.0